



## **The Progress Power (Gas Fired Power Station) Order**

# **APPLICATION TO MAKE A NON MATERIAL CHANGE TO THE PROGRESS POWER (GAS FIRED GENERATING STATION) ORDER**


## **Draft Progress Power (Gas Fired Power Station) Amendment Order**

**Planning Act 2008**

**THE INFRASTRUCTURE PLANNING (CHANGES TO, AND REVOCATION OF, DEVELOPMENT  
CONSENT ORDERS) REGULATIONS 2011**

**PINS Reference Number:** EN010060  
**Document Reference:** 3.1  
**Regulation Number:** Regulation 4  
**Author:** Pinsent Masons LLP

<b>Revision</b>	<b>Date</b>	<b>Description</b>
0	August 2016	Non Material Change

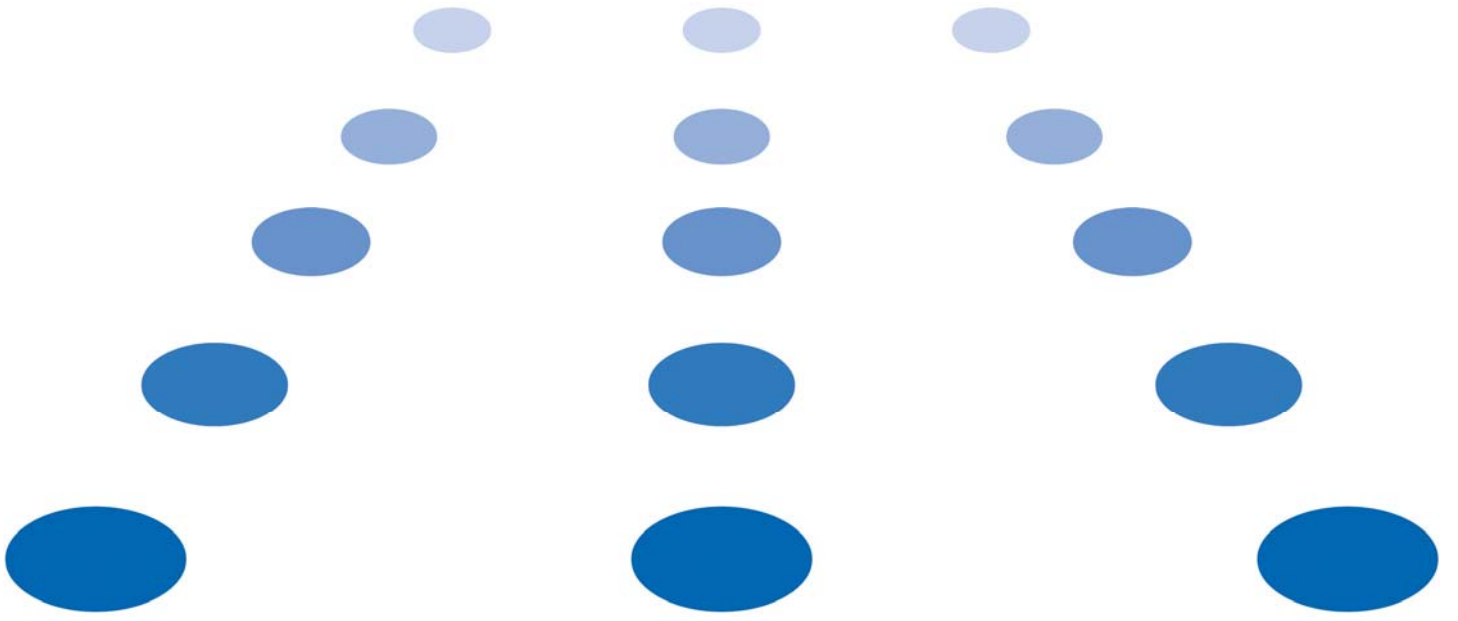

201[ ] No. \*\*\*

**INFRASTRUCTURE PLANNING**

**The Progress Power (Gas Fired Power Station) (Amendment)  
Order**

*Made* - - - - \*\*\*

*Coming into force* - - \*\*\*

An application has been made, under paragraph 2 of Schedule 6 to the Planning Act 2008(a), to the Secretary of State in accordance with the Infrastructure Planning (Changes to, and Revocation of, Development Consent Orders) Regulations 2011(b) for a non-material change to the Progress Power (Gas Fired Power Station) Order 2015(c).

The Secretary of State, having considered the application, and having consulted in accordance with regulation 7(1) of the Infrastructure Planning (Changes to, and Revocation of, Development Consent Orders) Regulations 2011(d), has decided to make this Order amending the Progress Power (Gas Fired Power Station) Order 2015.

Accordingly, the Secretary of State, in exercise of the powers conferred by paragraphs 2(1) and (9) of Schedule 6 to the Planning Act 2008, makes the following Order—

**Citation and commencement**

1. This Order may be cited as the Progress Power (Gas Fired Power Station) (Amendment) Order 201[X] and comes into force on [X] 201[X].

**Amendment to the Progress Power (Gas Fired Power Station) Order 2015**

2. The Progress Power (Gas Fired Power Station) Order 2015 (“the 2015 Order”) is amended in accordance with this Order.

**Amendments to Schedule 1 (authorised development)**

3. Schedule 1 (authorised development) of the 2015 Order is amended as follows—

- (a) in Work No. 1B(e), for “black start diesel generator” substitute “3 black start diesel generators where one gas turbine generator is constructed and 1 black start diesel generator where two, three, four or five gas turbine generators are constructed”; and

---

(a) 2008 c. 29. Paragraph 2 was amended by paragraph 4 of Schedule 8 to the Marine and Coastal Access Act 2009 (c. 23), by paragraphs 1 and 72 of Schedule 13 to the Localism Act 2011 (c. 20), and by section 28 of the Infrastructure Act 2015 (c. 7). There are other amendments to the Act that are not relevant to this Order.  
(b) S.I. 2011/2055, as amended by S.I. 2012/635 and S.I. 2015/760.  
(c) S.I. 2015/1570, as amended by S.I. 2016/736.  
(d) S.I. 2011/2055, as amended by S.I. 2012/635 and S.I. 2015/760.

(b) in Work Numbered 1D(i), for “other ancillary equipment” substitute “other ancillary equipment including external fin fan cooler”.

**Amendments to Schedule 2 (requirements)**

4. In Schedule 2 (requirements) of the 2015 Order Table 2 is replaced by Table 2 in Schedule 1 of this Order.

Signed by the authority of the Secretary of State for Business, Energy and Industrial Strategy

Address		<i>Name</i>
Date	Department for Business, Energy and Industrial Strategy	Title

SCHEDULE 1

Article 4

Table 2

<i>Building or structure</i>	<i>Maximum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Minimum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Maximum length (metres)</i>	<i>Minimum length (metres)</i>	<i>Maximum width (metres)</i>	<i>Minimum width (metres)</i>
Each gas turbine generator (where one gas turbine generator is constructed) (part of numbered work 1A)	19.0	-	50.0	-	40.0	-
Each gas turbine generator (where two gas turbine generators are constructed) (part of numbered work 1A)	19.0	-	30.0	-	30.0	-
Each gas turbine generator (where three, four or five gas turbine generators are constructed) (part of numbered work 1A)	10.0	-	36.0	-	23.0	-

<i>Building or structure</i>	<i>Maximum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Minimum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Maximum length (metres)</i>	<i>Minimum length (metres)</i>	<i>Maximum width (metres)</i>	<i>Minimum width (metres)</i>
Each exhaust gas emission flue stack (where one gas turbine generator is constructed) (part of numbered work 1A)	30.0	25.0	-	-	11.0 metres up to and including a height of 16.5 metres above 48.5m AOD and 10 metres from a height of 16.5 metres above 48.5m AOD to a height of 30.0 metres above 48.5m AOD	-
Each exhaust gas emission flue stack (where two gas turbine generators are constructed) (part of numbered work 1A)	30.0	25.0	-	-	8.4	-
Each exhaust gas emission flue stack (where three, four or five gas turbine generators are constructed) (part of numbered work 1A)	30.0	25.0	-	-	6.0	-

<i>Building or structure</i>	<i>Maximum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Minimum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Maximum length (metres)</i>	<i>Minimum length (metres)</i>	<i>Maximum width (metres)</i>	<i>Minimum width (metres)</i>
Control room/office/workshop (part of numbered work 1B)	6.0	-	29.0	-	23.0	-
Each black start diesel generator (part of numbered work 1B)	5.0	-	17.0	-	5.0	-
Raw/fire water tank (part of numbered work 1B)	11.0	-	11.0	-	11.0	-
Demineralised water tank (part of numbered work 1B)	2.0	-	2.0	-	2.0	-
Natural gas receiving station (part of numbered work 1B)	5.0	-	50.0	-	36.0	-
Gas treatment compound (part of numbered work 1B)	5.0	-	29.0	-	16.0	-
Switchyard / banking compound (numbered work 1C)	11.3	-	60.0	-	60.0	-
Switchgear Building (part of numbered work 1C)	11.3	-	21.0	-	15.0	-
Gatehouse (part of numbered work 1D)	4.5	-	9.0	-	8.0	-

<i>Building or structure</i>	<i>Maximum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Minimum height (metres above existing site level of approximately 48.5 metres AOD)</i>	<i>Maximum length (metres)</i>	<i>Minimum length (metres)</i>	<i>Maximum width (metres)</i>	<i>Minimum width (metres)</i>
Above ground installation (numbered work 3A)	3.0	-	72.0	-	52.0	-
Pipeline inspection gauge facility (part of numbered work 3A)	2.0	-	36.0	-	27.0	-
Minimum offtake connection (part of numbered work 3A)	2.0	-	36.0	-	25.0	-
Sealing end compound (part of numbered work 5)	12.5	-	22.0	-	45.0	-
Substation: (gas insulated substation) – (maximum compound size) (part of numbered work 5)	12.5	-	80.0	-	100.0	-
(gas insulated substation) – (indoor switchgear hall) (part of numbered work 5)	12.5	-	21.0	-	62.0	-
External fin fan cooler (where one gas turbine generator is constructed) (part of numbered work 1D)	6.0	-	13.0	-	10.0	-



## **EXPLANATORY NOTE**

*(This note is not part of the Order)*

This Order amends the Progress Power (Gas Fired Power Station) Order 2015, a development consent order under the Planning Act 2008, following an application made in accordance with the Infrastructure Planning (Changes to, and Revocation of, Development Consent Orders) Regulations 2011 for a non-material change under paragraph 2 of Schedule 6 to the Planning Act 2008. This Order amends the description of the authorised development (see article 3) and some of the requirements of the authorised development (see article 4).